



**RICHMOND**

EST. **TEXAS** 1837

# **2019**

# **WATER QUALITY**

# **REPORT**

City of Richmond  
Public Works

Main System - PWS 0790023  
Riverpark West - PWS 0790393  
Rivers Edge - PWS 0790445

# City Manager's Message


Dear Customers,

As you may be aware, the City of Richmond provides water and wastewater services to the City's customers and several adjacent Municipal Utility Districts. The 2019 Consumer Confidence Report includes the water quality results for the City of Richmond's source water and distribution system that includes Fort Bend County Municipal Utility Districts (MUD's) 187, 207, 215, and Williams Ranch MUD 1. Specific distribution sample results are also listed for MUD's that the City operates but have unique water system identification numbers for Fort Bend County MUD's 121, and 140.

The City has been very busy with planning for new infrastructure projects and rehabilitating and modernizing older facilities. Last year we updated our Integrated Utility Master Plan to serve as a guide to help ensure that we maintain excellent services to our customers now and in the future. This master plan projects potential service plans for development and maintaining our existing critical infrastructure.

This plan is available for review on the City's Public Works website at <https://www.richmondtx.gov/Home/ShowDocument?id=12526>. If you have any questions with regards to the Water Quality Report or the Master Plan, please contact our Public Works Department at (281)342-0559.

Thank you,



Terri Vela  
City Manager



*City of Richmond earned the Outstanding Public Drinking Water Award from the Texas Commission on Environmental Quality*

## This is your Water Quality Report for January 1 to December 31, 2019

This report is intended to provide you with important information about your drinking water and the efforts made by the water system to provide safe drinking water.

## Source Water Assessment Reports

TCEQ completed an assessment of your source water, and results indicate that some of our sources are susceptible to certain contaminants.

The sampling requirements for your water system is based on this susceptibility and previous sample data. Any detections of these contaminants will be found in this Consumer Confidence Report. For more information on source water assessments and protection efforts at our system please contact Public Works at (281)342-0559.





## Information about your Drinking Water

The City of Richmond Water Utilities goal and responsibility is to provide you safe and reliable drinking water. Our drinking water is obtained from surface water and ground water sources. Our ground water comes from the Gulf Coast Aquifer and our surface water comes from the Brazos River.

The sources of drinking water (both tap water and bottled water) include rivers, lakes, streams, ponds, reservoirs, springs, and wells. As water travels over the surface of the land or through the ground, it dissolves naturally-occurring minerals and, in some cases, radioactive material, and can pick up substances resulting from the presence of animals or from human activity.

We hope this information helps you become more knowledgeable about what is in your drinking water. Please feel free to contact our Utilities Coordinator at (281)342-0559 if you have any questions or would like to request a meeting regarding your drinking water.

## Important Health Information

You may be more vulnerable than the general population to certain microbial contaminants, such as *Cryptosporidium*, in drinking water. Infants, some elderly, or immunocompromised persons such as those undergoing chemotherapy for cancer; persons who have undergone organ transplants; those who are undergoing treatment with steroids; and people with HIV/AIDS or other immune system disorders, can be particularly at risk from infections. You should seek advice about drinking water from your physician or health care providers. Additional guidelines on appropriate means to lessen the risk of infection by *Cryptosporidium* are available from the EPA Safe Drinking Water Hotline at (800)426-4791.

## All Drinking Water May Contain Contaminants

Drinking water, including bottled water, may reasonably be expected to contain at least small amounts of some contaminants. The presence of contaminants does not necessarily indicate that water poses a health risk. More information about contaminants and potential health effects can be obtained by calling the EPA's Safe Drinking Water Hotline at (800)426-4791.

In order to ensure that tap water is safe to drink, EPA prescribes regulations which limit the amount of certain

contaminants in water provided by public water systems. FDA regulations establish limits for contaminants in bottled water which must provide the same protection for public health.

Contaminants may be found in drinking water that may cause taste, color, or odor problems. These types of problems are not necessarily causes for health concerns. For more information on taste, odor, or color of drinking water, please contact the Public Works Department.

## Contaminants that may be present in source water include:

**MICROBIAL CONTAMINANTS** such as viruses and bacteria, which may come from sewage treatment plants, septic systems, agricultural livestock operations, and wildlife.

**INORGANIC CONTAMINANTS** such as salts and metals, which can be naturally-occurring or result from urban storm water runoff, industrial or domestic wastewater discharges, oil and gas production, mining, or farming.

**PESTICIDES AND HERBICIDES** which may come from a variety of sources such as agriculture, urban storm water runoff, and residential uses.

**ORGANIC CHEMICAL CONTAMINANTS** including synthetic and volatile organic chemicals, which are by-products of industrial processes and petroleum production, and can also come from gas stations, urban storm water runoff, and septic systems.

**RADIOACTIVE CONTAMINANTS** which can be naturally-occurring or be the result of oil and gas production and mining activities.

### Lead in Homes

If present, elevated levels of lead can cause serious health problems, especially for pregnant women and young children. Lead in drinking water is primarily from materials and components associated with service lines and home plumbing. We are responsible for providing high quality drinking water, but we cannot control the variety of materials used in plumbing components. When your water has been sitting for several hours, you can minimize the potential for lead exposure by flushing your tap for 30 seconds to 2 minutes before using water for drinking or cooking. If you are concerned about lead in your water, you may wish to have your water tested. Information on lead in drinking water, testing methods, and steps you can take to minimize exposure is available from the Safe Drinking Water Hotline or at:

<http://www.epa.gov/safewater/lead>

## Definitions and Abbreviations

The following tables contain scientific terms and measures, some of which may require explanation.

**ACTION LEVEL:** The concentration of a contaminant which, if exceeded, triggers treatment or other requirements which a water system must follow.

**ACTION LEVEL GOAL (ALG):** The level of a contaminant in drinking water below which there is no known or expected risk to health. ALGs allow for a margin of safety.

**AVG:** Regulatory compliance with some MCLs are based on running annual average of monthly samples.

**LEVEL 1 ASSESSMENT:** A Level 1 assessment is a study of the water system to identify potential problems and determine (if possible) why total coliform bacteria have been found in our water system.

**LEVEL 2 ASSESSMENT:** A Level 2 assessment is a very detailed study of the water system to identify potential problems and determine (if possible) why an E. coli MCL violation has occurred and/or why total coliform bacteria have been found in our water system on multiple occasions.

**MAXIMUM CONTAMINANT LEVEL OR MCL:** The highest level of a contaminant that is allowed in drinking water. MCLs are set as close to the MCLGs as feasible using the best available treatment technology.

**MAXIMUM CONTAMINANT LEVEL GOAL OR MCLG:** The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs allow for a margin of safety.

**MAXIMUM RESIDUAL DISINFECTANT LEVEL OR MRDL:** The highest level of a disinfectant allowed in drinking water. There is convincing evidence that addition of a disinfectant is necessary for control of microbial contaminants.

**MAXIMUM RESIDUAL DISINFECTANT LEVEL GOAL OR MRDLG:** The level of a drinking water disinfectant below which there is no known or expected risk to health. MRDLGs do not reflect the benefits of the use of disinfectants to control microbial contaminants.

**MFL:** million fibers per liter (a measure of asbestos)

**MREM:** millirems per year (a measure of radiation absorbed by the body)

**NA:** not applicable

**NTU:** nephelometric turbidity units (a measure of turbidity)

**PCI/L:** picocuries per liter (a measure of radioactivity)

**PPB:** micrograms per liter or parts per billion - or one ounce in 7,350,000 gallons of water

**PPM:** milligrams per liter or parts per million - or one ounce in 7,350 gallons of water

**PPQ:** parts per quadrillion, or picograms per liter (pg/L)

**PPT:** parts per trillion, or nanograms per liter (ng/L)

**TREATMENT TECHNIQUE OR TT:** A required process intended to reduce the level of a contaminant in drinking water.

# CITY OF RICHMOND

(Includes MUD 187, MUD 207, MUD 215, and Williams Ranch MUD 1)

## 2019 Water Quality Test Results

### Lead and Copper

Lead and Copper	Date Sampled	MCLG	Action Level (AL)	90th Percentile	# Sites Over AL	Units	Violation	Likely Source of Contamination
Copper	2019	1.3	1.3	0.17	0	ppm	N	Erosion of natural deposits; Leaching from wood preservatives; Corrosion of household plumbing systems.
Lead	2019	0	15	2	1	ppb	N	Corrosion of household plumbing systems; Erosion of natural deposits.

### Inorganic Contaminants

Inorganic Contaminants	Collection Date	Highest Level Detected	Range of Individual Samples	MCLG	MCL	Units	Violation	Likely Source of Contamination
Arsenic	2019	3.3	0 - 3.3	0	10	ppb	N	Erosion of natural deposits; Runoff from orchards; Runoff from glass and electronics production wastes.
Barium	2019	0.18	0.0706 - 0.18	2	2	ppm	N	Discharge of drilling wastes; Discharge from metal refineries; Erosion of natural deposits.
Fluoride	2019	0.2	0.15 - 0.31	4	4.0	ppm	N	Erosion of natural deposits; Water additive which promotes strong teeth; Discharge from fertilizer and aluminum factories.
Nitrate [measured as Nitrogen]	2019	1	0 - 0.72	10	10	ppm	N	Runoff from fertilizer use; Leaching from septic tanks, sewage; Erosion of natural deposits.

### Radioactive Contaminants

Radioactive Contaminants	Collection Date	Highest Level Detected	Range of Individual Samples	MCLG	MCL	Units	Violation	Likely Source of Contamination
Combined Radium 226/228	2019	1.07	0 - 1.07	0	5	pCi/L	N	Erosion of natural deposits.
Gross alpha excluding radon and uranium	2019	7	4 - 7	0	15	pCi/L	N	Erosion of natural deposits.
Uranium	2019	2.3	1.9 - 2.3	0	30	ug/l	N	Erosion of natural deposits.

## Disinfection By-Products

Disinfection By-Products	Collection Date	Highest Level Detected	Range of Individual Samples	MCLG	MCL	Units	Violation	Likely Source of Contamination
Chlorite	2019	0.522	0 - 0.522	0.8	1	ppm	N	By-product of drinking water disinfection.
Haloacetic Acids (HAA5)	2019	21	0 - 26.8	No goal for the total	60	ppb	N	By-product of drinking water disinfection.
Total Trihalomethanes (TTHM)	2019	47	2.7 - 55.4	No goal for the total	80	ppb	N	By-product of drinking water disinfection.

\* The value in the Highest Level or Average Detected column is the highest average of all HAA5 sample results collected at a location over a year.

\* The value in the Highest Level or Average Detected column is the highest average of all TTHM sample results collected at a location over a year.

## Disinfectant Residual

Disinfectant Residual	Year	Average Level	Minimum Level	Maximum Level	MRDL	MRDLG	Unit of Measure	Violation (Y/N)	Source in Drinking Water
Chloramines (Chlorine Residual, Total)	2019	3.02	1.45	3.89	4	4	ppm	No	Water additive used to control microbes.

## Turbidity

Turbidity	Level Detected	Limit (Treatment Technique)	Violation	Likely Source of Contamination
Highest single measurement	0.34 NTU	1.0 NTU	N	Soil runoff.
Lowest monthly % meeting limit	100%	0.3 NTU	N	Soil runoff.

Turbidity is a measurement of the cloudiness of the water caused by suspended particles. We monitor it because it is a good indicator of water quality and the effectiveness of our filtration system and disinfectants.

## Total Organic Carbon

The percentage of Total Organic Carbon (TOC) removal was measured each month and the system met all TOC removal requirements set, unless a TOC violation is noted in the violations section.

### Water Accountability

The City of Richmond is required to submit a Water Audit Report to the Texas Water Development Board annually. In 2019, the City of Richmond pumped 802,233,837 gallons with 94.57% accountability.

# FORT BEND COUNTY MUD 121

## 2019 Water Quality Test Results

### Lead and Copper

Lead and Copper	Date Sampled	MCLG	Action Level (AL)	90th Percentile	# Sites Over AL	Units	Violation	Likely Source of Contamination
Copper	2019	1.3	1.3	0.466	0	ppm	N	Erosion of natural deposits; Leaching from wood preservatives; Corrosion of household plumbing systems.
Lead	2019	0	15	2	1	ppb	N	Corrosion of household plumbing systems; Erosion of natural deposits.

### Disinfection By-Products

Disinfection By-Products	Collection Date	Highest Level Detected	Range of Individual Samples	MCLG	MCL	Units	Violation	Likely Source of Contamination
Haloacetic Acids (HAA5)	2019	10	10 - 10	No goal for the total	60	ppb	N	By-product of drinking water disinfection.
Total Trihalomethanes (TTHM)	2019	29	28.8 - 28.8	No goal for the total	80	ppb	N	By-product of drinking water disinfection.

\* The value in the Highest Level or Average Detected column is the highest average of all HAA5 sample results collected at a location over a year.

\* The value in the Highest Level or Average Detected column is the highest average of all TTHM sample results collected at a location over a year.

### Inorganic Contaminants

Inorganic Contaminants	Collection Date	Highest Level Detected	Range of Individual Samples	MCLG	MCL	Units	Violation	Likely Source of Contamination
Nitrate [measured as Nitrogen]	2019	0.38	0.38 - 0.38	10	10	ppm	N	Runoff from fertilizer use; Leaching from septic tanks, sewage; Erosion of natural deposits.

### Disinfectant Residual

Disinfectant Residual	Year	Average Level	Minimum Level	Maximum Level	MRDL	MRDLG	Unit of Measure	Violation (Y/N)	Source in Drinking Water
Chloramines (Chlorine Residual, Total)	2019	2.48	1.53	3.05	4	4	ppm	No	Water additive used to control microbes.

### Water Accountability

Fort Bend County MUD 121 is required to submit a Water Audit Report to the Texas Water Development Board annually. In 2019, the City of Richmond pumped 128,307,000 gallons to MUD 121 with 95.37% accountability.

# FORT BEND COUNTY MUD 140

## 2019 Water Quality Test Results

### Lead and Copper

Lead and Copper	Date Sampled	MCLG	Action Level (AL)	90th Percentile	# Sites Over AL	Units	Violation	Likely Source of Contamination
Copper	09/12/2017	1.3	1.3	0.095	0	ppm	N	Erosion of natural deposits; Leaching from wood preservatives; Corrosion of household plumbing systems.
Lead	09/12/2017	0	15	1.6	0	ppb	N	Corrosion of household plumbing systems; Erosion of natural deposits.

### Disinfection By-Products

Disinfection By-Products	Collection Date	Highest Level Detected	Range of Individual Samples	MCLG	MCL	Units	Violation	Likely Source of Contamination
Haloacetic Acids (HAA5)	2019	20	0 - 19.5	No goal for the total	60	ppb	N	By-product of drinking water disinfection.
Total Trihalomethanes (TTHM)	2019	46	0 - 45.5	No goal for the total	80	ppb	N	By-product of drinking water disinfection.

\* The value in the Highest Level or Average Detected column is the highest average of all HAA5 sample results collected at a location over a year.

\* The value in the Highest Level or Average Detected column is the highest average of all TTHM sample results collected at a location over a year.

### Inorganic Contaminants

Inorganic Contaminants	Collection Date	Highest Level Detected	Range of Individual Samples	MCLG	MCL	Units	Violation	Likely Source of Contamination
Nitrate [measured as Nitrogen]	2019	0.1	0.1 - 0.1	10	10	ppm	N	Runoff from fertilizer use; Leaching from septic tanks, sewage; Erosion of natural deposits.

### Disinfectant Residual

Disinfectant Residual	Year	Average Level	Minimum Level	Maximum Level	MRDL	MRDLG	Unit of Measure	Violation (Y/N)	Source in Drinking Water
Chloramines (Chlorine Residual, Total)	2019	2.73	1.28	3.75	4	4	ppm	No	Water additive used to control microbes.


### Coliform Bacteria

Maximum Contaminant Level Goal	Total Coliform Maximum Contaminant Level	Highest No. of Positive	Fecal Coliform or E. Coli Maximum Contaminant Level	Total No. of Positive E. Coli or Fecal Coliform Samples	Violation	Likely Source of Contamination
0	1 positive monthly sample	1	0	0	N	Naturally present in the environment.

### Water Accountability

Fort Bend County MUD 140 is required to submit a Water Audit Report to the Texas Water Development Board annually. In 2019, the City of Richmond pumped 83,532,400 gallons to MUD 140 with 97.25% accountability.

# Service Area Map

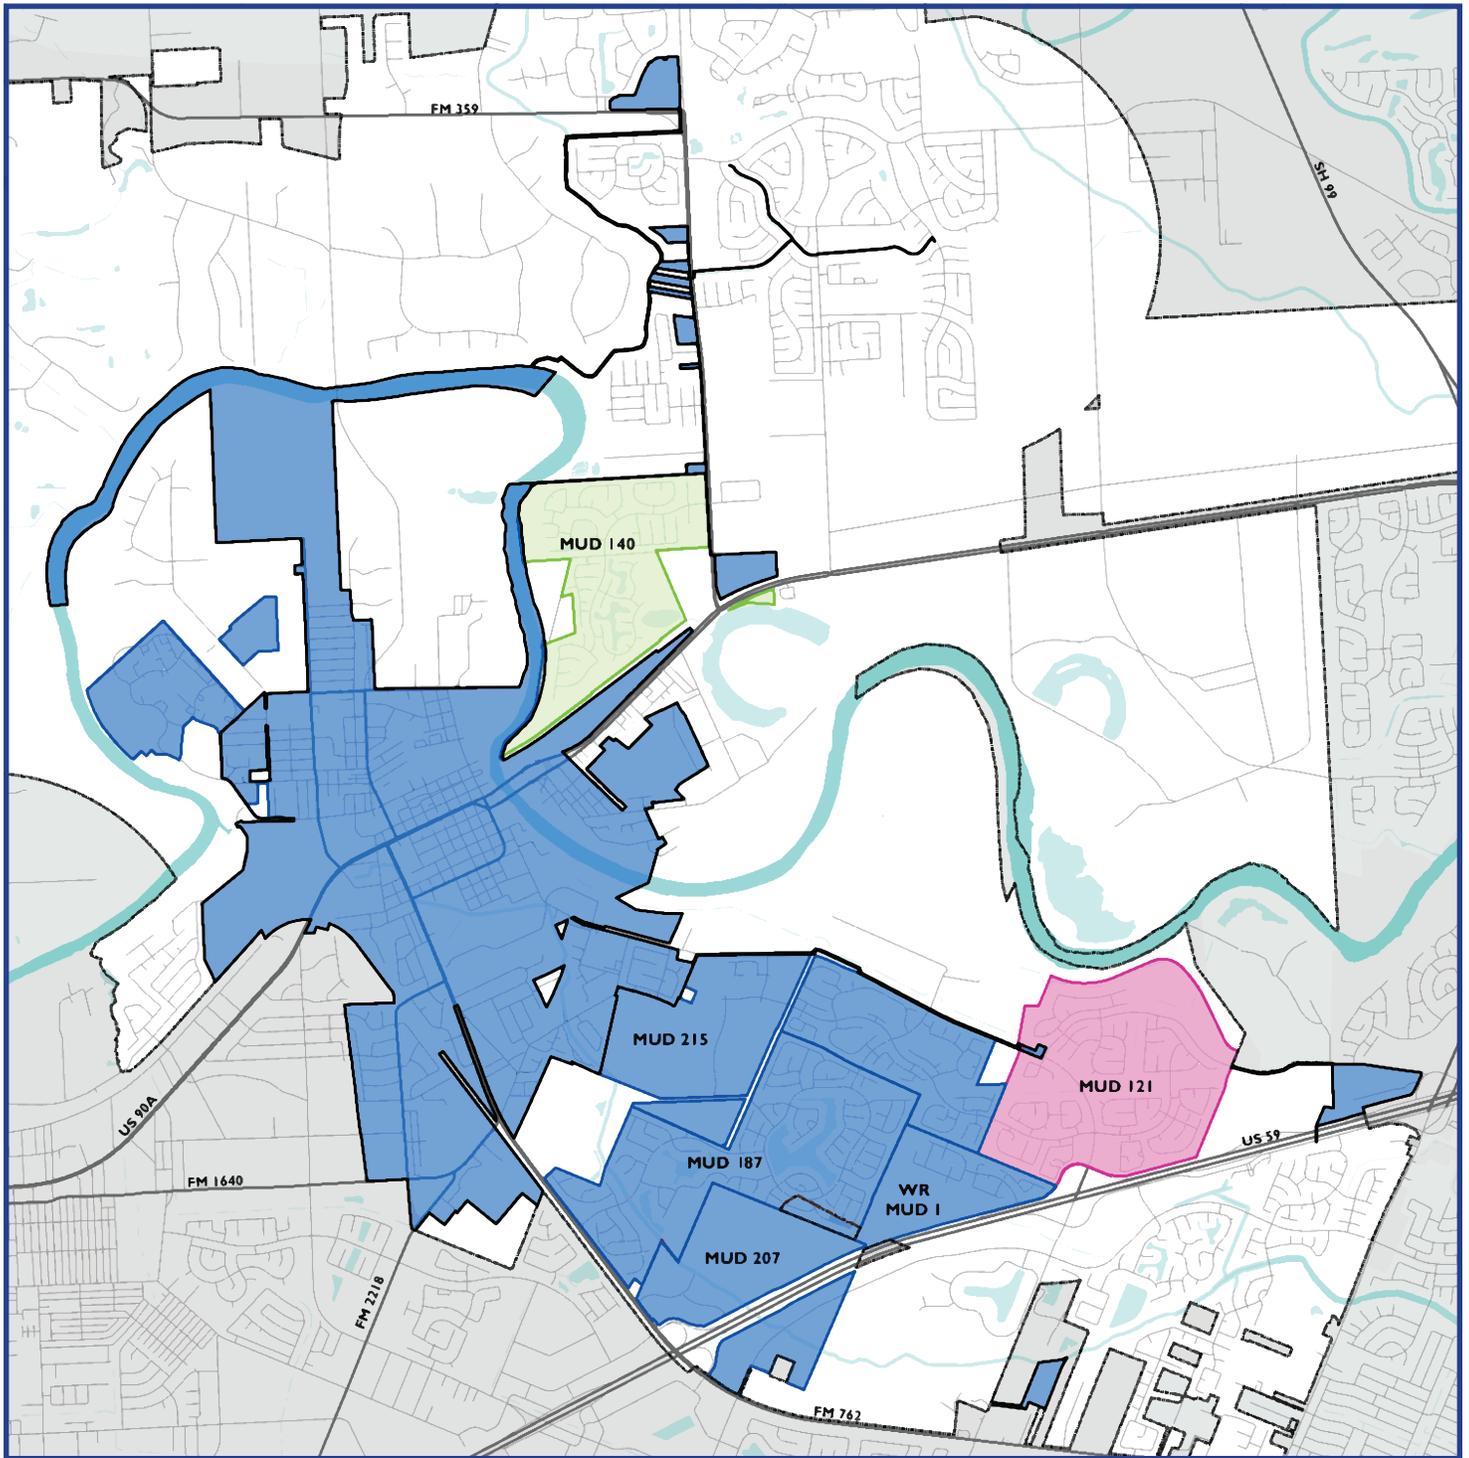

 Main System

 MUD 140 - Rivers Edge

 MUD 121 - Riverpark West

## Report Water Leaks

Delivering water to our homes, businesses, schools, fire hydrants and numerous other needs is the job of an extensive water distribution system. The distribution system is nearly hidden from view since it is chiefly underground. When a leak does occur please report the leak to the Public Works Department at (281)342-0559, we provide 24-hour assistance, 7-days a week.

## Landscape Irrigation

Water conservation can be achieved by following a few tips below. These recommendations can help reduce the use of water consumption and still maintain a beautiful yard.


- Mulch trees and garden beds
- Water deeply, not frequently
- Conduct monthly sprinkle inspections to ensure the system is operating efficiently
- Cut grass no shorter than 2-3 inches tall
- Use water-saving irrigation components such as rotary nozzles, pressure regulated spray heads, and rain sensors
- Adjust your irrigation schedule throughout the year according to current soil conditions and seasonal weather conditions

## Avoid Sanitary Sewer Back-ups

Every time you wash your hands, rinse a dish, run the washing machine, or flush the toilet, water flows from your sanitary sewer line to a city-wide sewer system. With that being said, a little clog could cause a big problem for every drain and toilet in your home. Sewer lines can become clogged by fat, oil, and grease among other items. To prevent sewer line stoppages, dispose of the following items in the trash, not in the sink drain, garbage disposal, or toilet.

- Flushable Wipes
- Oil and Grease
- Egg Shells
- Fruit and Vegetable Peels
- Hygiene Products
- Diapers

If you are experiencing a stoppage, please call the Public Works Department first at (281)342-0559. The technician will investigate the problem and determine whether the stoppage is in the homeowner's wastewater line or the City's collection system.

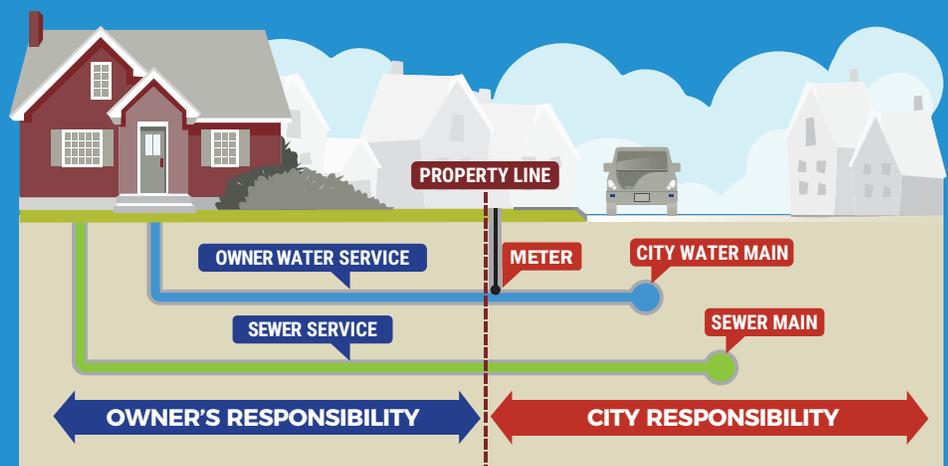



**City of Richmond**  
402 Morton Street  
Richmond, TX 77469

Prsrt Std  
US Postage  
PAID  
Richmond TX  
Permit No 33

## Customer Service is Our Number One Priority

We take pride in the water that is provided to our customers and we are continually striving to improve our service to you. To accomplish this goal, we need your help. Any time you find your water quality or service response is below your expectations, please contact us at (281) 342-0559. We will respond promptly and professionally.

### **EN ESPAÑOL**

Este reporte incluye información importante sobre el agua para tomar. Si tiene preguntas o' quiere discutir sobre este reporte en español, favor de llamar al tel. (281) 342-0559.